GUE, GUB Junction Boxes

- Cl. I, Div. 1 & 2, Groups B, C, D Cl. II, Div. 1, Groups E, F, G Cl. II, Div. 2, Groups F, G CL III NEMA 4*, 7BCD, 9EFG Ex d IIC T6, IP66† Ex d IIC, IP66, ATEX certified
- Explosionproof Dust-lanitionproof Raintight Wet Locations Watertight

Applications:

1E

GUE, GUB series junction boxes are used in threaded rigid conduit systems in hazardous areas:

- To function as a splice box, pull box or equipment and device enclosure
- To house wiring
- · Indoors and outdoors

Features:

- Threaded construction throughout permits use in hazardous areas
- Bodies have thick walls so they can be factory or field drilled and tapped to meet NEC/CEC requirements for Class I hazardous areas
- Covers are provided with a neoprene "O" ring gasket to meet NEMA/EEMAC 4 requirements for a watertight seal§
- Internal grounding lug provides a means to ground enclosed equipment
- · Boxes are machined for field installed mounting plates
- GUB boxes are ATEX certified when ordered with Suffix SA ATEX (not available for GU and GUE)

Certifications and **Compliances:**

- NEC/CEC:
- Class I, Division 1 & 2, Groups B, C, D Class II, Division 1, Groups E, F, G Class II, Division 2, Groups F, G Class III
- UL Standard: 1203
- CSA Standard: C22.2 No. 30
- ATEX: Ex d IIC, IP66† ATEX Certificate: PTB 01 ATEX 1019 U
- Ex d IIC, IP66, ATEX certified

Standard Materials:

- Bodies Feralov[®] iron allov
- Covers copper-free aluminum

Standard Finishes:

- Feraloy iron alloy GU, GUE, GUB01, GUB02 - electrogalvanized and aluminum acrylic paint. All other boxes - zinc chromate primer and aluminum acrylic paint
- Copper-free aluminum natural

Options:

Description · Copper-free aluminum bodies and covers (GUB01, GUB02, GUB03, GUB06 only)..... ATEX certified (GUB01 SA,

- GUB02 SA, GUB03 SA, GUB06 SA only)..... SA ATEX++ • Factory installed mounting plate
- for relays, terminal blocks, electrical devices, etc
- Factory installed terminal blocks. Information on request

Junction Boxes Without Hubst

GU


4¹⁵/₁₆" x 4¹⁵/₁₆" x 4¹/₈" 3⁵/₆" cover openina GUE 5⁵/₁₆" x 5⁵/₁₆" x 5³/₈" 3⁵/₆" cover opening



GUB01 6¹/₂" x 7" x 5³/₄" 5³/₈" cover opening GUB02 8" x 10" x 5⁷/₈"


7" cover opening GUB06

81/2" x 10" x 67/8" 7" cover opening



11" × 12" × 8¹³/₁₆" 95/8" cover opening GUB01110* $14"\times18"\times13'\!/_{\!2}"$ 121/4" cover opening GUB15151

19" × 21" × 16⁵/₈" 16³/₄" cover opening



GUB08 $8^{1/2}$ " × 10" × 6¹³/₁₆ 7" cover opening

Ordering Information:

Junction boxes listed can be furnished with drilled and tapped conduit openings, subject to the limitations of maximum opening, number and spacing shown in Tables 1, 2 and 4.

To Order:

Step 1

Select the box required from photos at left and dimensional drawings on next page.

Step 2

Select standard conduit arrangement from Table 1.

Step 3

Determine maximum size conduit opening required from Table 2 (consider conduit opening spacing from Table 4).

Step 4

Select appropriate symbol for required drilled and tapped holes from Table 3.

Example:

Step 1 – box required GUB06 Step 2 - arrangement 108 Step 3 - openings - 11/2" at "a" and "c"; 1" at "b" and "d".

Step 4 - symbols are substituted and written in clockwise order starting with location "a". For this example:

FCFC Complete Cat. No. is made up of three parts: Part 1 - box number; Part 2 arrangement number; Part 3 - symbols for conduit openings. For this example: GUB06-108-FCFC. When no opening is required at a particular location, use symbol "0" (zero).

If none of the standard arrangements meet requirements, send a sketch showing junction box number with size and location of each opening desired.

For conduit liner ordering information, see page 860. *NEMA 4 not available on GUB01110 and GUB15151. †Order suffix SA ATEX. GUB01110 and GUB15151 are rated IP54 ++Please consult Modified Products for conduit entry arrangement options. ±Dimensions provided are external. §GUB01110 listed for Class I, Div. 1, Groups C & D only in Canada (CSA).

Crouse-Hinds by E:T.N

ш


Suffix

SA.

MP

Table 1

Arrangements of Drilled and Tapped Conduit Openings - For other arrangements, send sketch and complete description

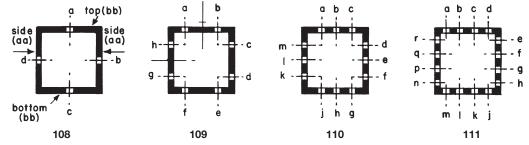

Conduit opening arrangements shown in the illustration should meet the majority of requirements. These GUB junction boxes will be supplied with drilled and tapped openings up to the maximum size and number shown in Table 2.

Table 2

Maximum Size & No. of Drilled & Tapped Holes

	Тор	& Botton	n (bb)†		Eac	Each Side (aa)†			Back‡			
Cat. #	1	2	3	4	1	2	3	4	1	2	3	4
Group D* GU GUE GUB01 GUB02 GUB06 GUB08 GUB03 GUB03 GUB04 GUB01110 GUB15151	1 2 2 2 2 2 2 2 2 5	1 1 2 2 2 2 2 2 4	³ /4 1 1 1 ¹ /2 2 3 ¹ /2	3/4 3/4 1 1 1 ¹ /2 2 ¹ /2	1 2 2 2 2 2 2 2 2 5	1 1 2 2 2 2 2 2 2 4	1 1½ 1½ 1½ 2 2 4	^{1/2} 1 1 1 ^{1/4} 2 3	321 ∛₄ 224466	1 ³ / ₄ ³ / ₄ 2 2 4 4 6 6	³ / ₄ ³ / ₄ ³ / ₄ 2 2 3 ¹ / ₂ 4 6	^{3/4} ^{3/4} ^{3/4} 2 2 3 3 3 ^{1/2} 6
Group C▲ GU GUE GUB01 GUB02 GUB06 GUB08 GUB03 GUB04 GUB01110 GUB15151	1 2 2 2 2 2 2 2 2 5	1 1½ 1½ 1½ 1½ 2 2 2 4	1/2 3/4 3/4 11/4 11/4 2 3	³ /4 ³ /4 1 ¹ /4 2	1 2 2 2 2 2 2 2 2 5	1 1'/4 2 2 2 2 2 2 2 2 4	1/2 11/4 11/4 11/4 11/2 2 31/2	1/2 1/2 1 1 2 21/2	32 ³ ⁄ ₄ 22 4 4 6 6	1 1 3/4 2 2 31/2 31/2 6 6	³ / ₄ ³ / ₄ ³ / ₄ 2 2 2 ¹ / ₂ 2 ¹ / ₂ 4 6	3/4 3/4 3/4 11/2 11/2 21/2 21/2 31/2 5
Group B■ GU GUE GUB01 GUB02 GUB06 GUB08 GUB03 GUB04 GUB01110 GUB15151	1 2 2 2 2 2 2 2 2 2 2 4	1 1½ 1½ 1½ 1½ 2 2 2 4	1/2 3/4 3/4 3/4 11/4 11/4 2 31/2	³ /4 ³ /4 1 ¹ /4 2 ¹ /2	1 2 2 2 2 2 2 2 2 2 4	1 1'/4 2 2 2 2 2 2 2 2 4	1/2 11/4 11/4 11/4 11/2 2 31/2	1/2 1/2 1 1 2 21/2	3 3⁄4 2 2 4 4 4 4	1 1 3/4 2 2 31/2 31/2 4	3/4 3/4 3/4 2 2 2 ¹ /2 2 ¹ /2 4	3/4 3/4 3/4 11/2 11/2 21/2 21/2 4 4

Table 3

Drilled & Tapped Holes

Size	Symbol
1/2	А
3/4	В
1	С
1 ¹ / ₄	E
1 ¹ / ₂	F
2	G
2 ¹ / ₂	Н
3	J
31/2	K
4	L
none	0

*Group D chart is based on use of staggered unions. If adjacent unions are desired, additional spacing may be necessary. †Sidewall and top and bottom sizes are based on all openings being in line. ‡Backwall sizes are based on: two per side – diagonal corners; four per side – one in each corner; three per side –

Ladwala acts are based on two per side – diagonal contract, four per side – one in each content, time per triangular pattern with two on adjacent corners on long wall and third in center of opposite long wall. ▲ Conduit seals are required within 1/2" of all conduit entrances for Class I, Group C hazardous locations. ■ Conduit seals are required within 1/2" of all conduit entrances for Class I, Group B hazardous locations.


For conduit liner ordering information, see page 860. For ATEX, please consult Modified Products for conduit entry arrangement options.

Crouse-Hinds by F:T•N

1E

1E GUE, GUB Junction Boxes

Dimensions

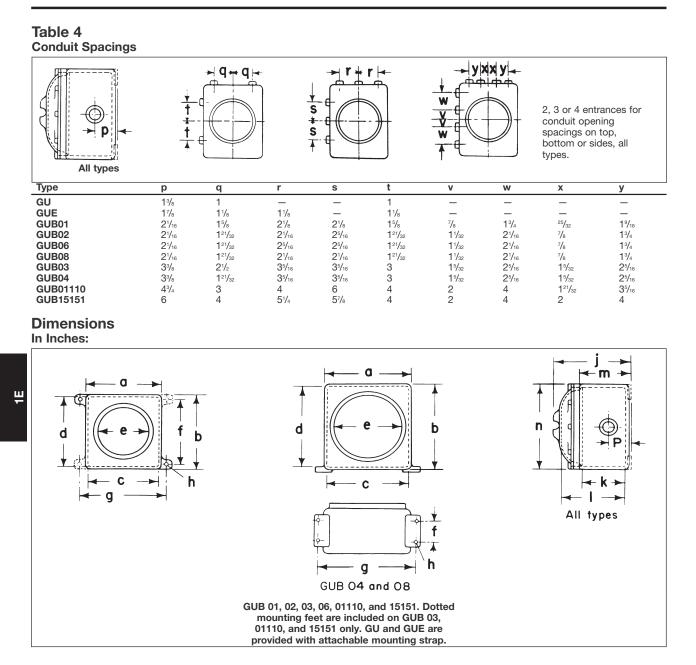

Туре	а	b	c‡	d‡	е	f	g	h	j	k‡	I‡	m	n
GU	4 ¹⁵ / ₁₆	4 ¹⁵ / ₁₆	3 ¹³ / ₁₆	3 ¹³ / ₁₆	35/8	_	_	_	4 ¹ / ₈	1 %16	37/16	2 ³ /8	4 ¹ / ₈
GUE	55/16	55/16	4 ³ / ₁₆	4 ³ / ₁₆	35/8	_	_	_	5³/8	2 ¹ / ₄	37/16	3 ¹ / ₂	4 ¹ / ₈
GUB01	61/2	7	61/2	57/8	5 ³ /8	5 ³ /4	7 ¹ / ₂	13/32	5 ³ / ₄	31/16	41/2	41/16	61/4
GUB02	8	10	7 ¹ /8	9 ¹ / ₈	7	8 ³ / ₄	9	¹³ / ₃₂	57/8	3	45/8	4 ¹ / ₁₆	7 ³ / ₄
GUB06	81/2	10	7 ³ /8	87/8	7	8 ³ / ₄	9 ¹ / ₂	7/16	7 ³ /8	4 ¹ / ₄	5 ¹³ /16	5 ¹ / ₄	7 ³ / ₄
GUB08	81/2	10	7 ³ / ₈	87/8	7	21/2	9 ⁵ /8	7/16	7 ³/8	41/4	5 ³ / ₁₆	51/4	73/4
GUB03	11	12	9 ³ / ₄	10 ³ / ₄	9 ⁵ / ₈	10 ³ /4	12 ¹ /8	7/16	813/16	5	7 ³ /8	6 ⁵ /8	11
GUB04	11	12	9 ³ / ₄	10 ³ / ₄	9 ⁵ / ₈	3 ¹ / ₂	12 ¹ /8	7/16	811/16	5	7 ³ /8	61/2	11
GUB01110	141/16	181/16	13	17	121/4	16	16	1	13 ¹ / ₂	613/16	103/4	9 ³ / ₄	14
GUB15151	207/8	187/8	19 ¹ / ₈	17 ¹ / ₈	16 ³ / ₄	18	21	1	165/8	9	13 ³ / ₁₆	113/8	18

‡ Inside dimensions.

For conduit liner ordering information, see page 860


Crouse-Hinds

GUE, GUB Junction Boxes

Mounting Plate Dimensions

Table 5

Mounting Plate Dimensions

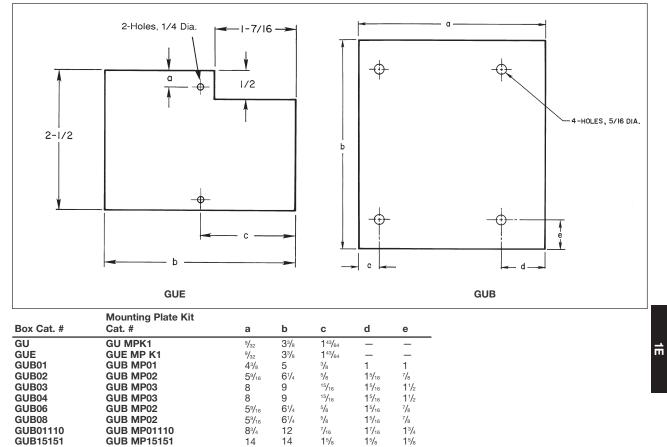

For conduit liner ordering information, see page 860

1E Threaded Covers for GUB Junction Boxes

Cl. I, Div. 1 and 2, Groups B‡, C, D Cl. II, Div. 1, Groups E, F, G Cl. II, Div. 2, Groups F, G Cl. III NEMA 7B‡CD, 9EFG Explosionproof Dust-Ignitionproof Raintight Wet Locations Watertight

Applications:

GUB and EPC threaded covers are used with GUB boxes in control systems in hazardous areas:

- Indoors and outdoors
- In three categories:

Flat – for normal use; furnished with standard GUB boxes

Glass window – to provide visibility of meter indications when used to enclose meters

Domed – for increasing volume of GUB to make it easier to splice and pull large conductors

Features:

- Domed more suitable for use when splices of heavy conductors are made and enclosed, since the conductors may be pulled in with the ends outside the box. After the splices are made, they do not have to be crowded back into the box
- Glass window has maximum diameter glass to give best visibility. In selecting, the diameter of the meter face should match or be slightly smaller than window diameter

Certifications and Compliances:

 NEC: UL Standard 1203 GUB0101, -0102, -0103, -714, -7110, EPC2110, EPC2151 Class I, Division 1 and 2, Groups B, C, D Class II, Division 1, Groups E, F, G Class II, Division 2, Groups F, G Class III

All other covers:

Class I, Division 1 and 2, Group D Class II, Division 1, Groups E, F, G Class II, Division 2, Groups F, G Class III

 CEC: CSA Standard C22.2 No. 30 Class I, Division 1 and 2, Group D Class II, Division 1, Groups E, F, G Class II, Division 2, Groups F, G Class III

GUB covers are suitable for use in hazardous areas only when used with appropriate GUB series enclosures.

Standard Materials:

Copper-free aluminum

Standard Finishes:

Natural

 Bodies are grouped by size of cover opening and take any of the covers shown in the group.
Check certifications and compliances for specific

hazardous area ratings for each catalog #.

For conduit liner ordering information, see page 860.





GUB glass cover



GUB dome cover

Ordering Information


	Flat	Glass Window	Dome Cover			
Body † Size	Cover Cat. #	Cover Cat. #	Cat. #	Nominal Depth		
GUB01	GUB0101	GUB0110	GUB714 GUB7110	4 10		
GUB02 GUB06 GUB08	GUB0102	GUB0108	GUB726	6		
GUB03 GUB04	GUB0103	GUB0109	GUB738 GUB7316	10 17		
GUB01110	EPC2110		EPC2115	5		
GUB15151	EPC2151					

Specify body and conduit openings in normal manner (see page 723) and state Cat. No. of

cover required.

Dimensions

In Inches:



(

Flat Covers

Cat. #	а	b	Thread Size d
GUB0101	6 ⁵ /16	1 ²³ / ₃₂	5 ⁵ / ₈ - 12
GUB0102	7 ¹³ /16	1 ¹⁵ / ₁₆	7 ¹ / ₈ - 12
GUB0103	11 ¹ /16	2 ³ / ₄	9 ³ / ₄ - 8
EPC2110	12 ⁷ /8	5 ⁵ / ₃₂	12.660 - 8
EPC2151	17	5 ⁹ / ₁₆	16.910 - 8

Glass	Covers	
		Window
		Opening

Cat. #	а	b	c	d
GUB0110 GUB0108 GUB0109	713/16	21/16	43/4	5 ⁵ / ₈ - 12 7 ¹ / ₈ - 12 9 ³ / ₄ - 8

Thread

Dome Covers

Donne C	Uver5		For Dimensions C					
Cat. #	а	b	GUB02	GUB06	GUB08	all others	d	
GUB714	5 ¹ / ₁₆	2 ³ / ₄				4 ³ / ₁₆	4	
GUB7110	5 ¹ / ₁₆	9 ¹ / ₈				4 ³ / ₁₆	10¾	
GUB726	6 ³ /8	5 ¹ /8	41/8	51/8	51/8		63/4	
GUB738	8 ⁷ / ₈	8				65/8	10 ¹ / ₂	
GUB7316	87/8	151/4				65/8	173/8	
EPC2115	11% 16	3%16				81/2	6%/16	
EPC21116	11 %16	1 4%/16				81/2	17 ⁹ / ₁₆	

Crouse-Hinds